
944x667

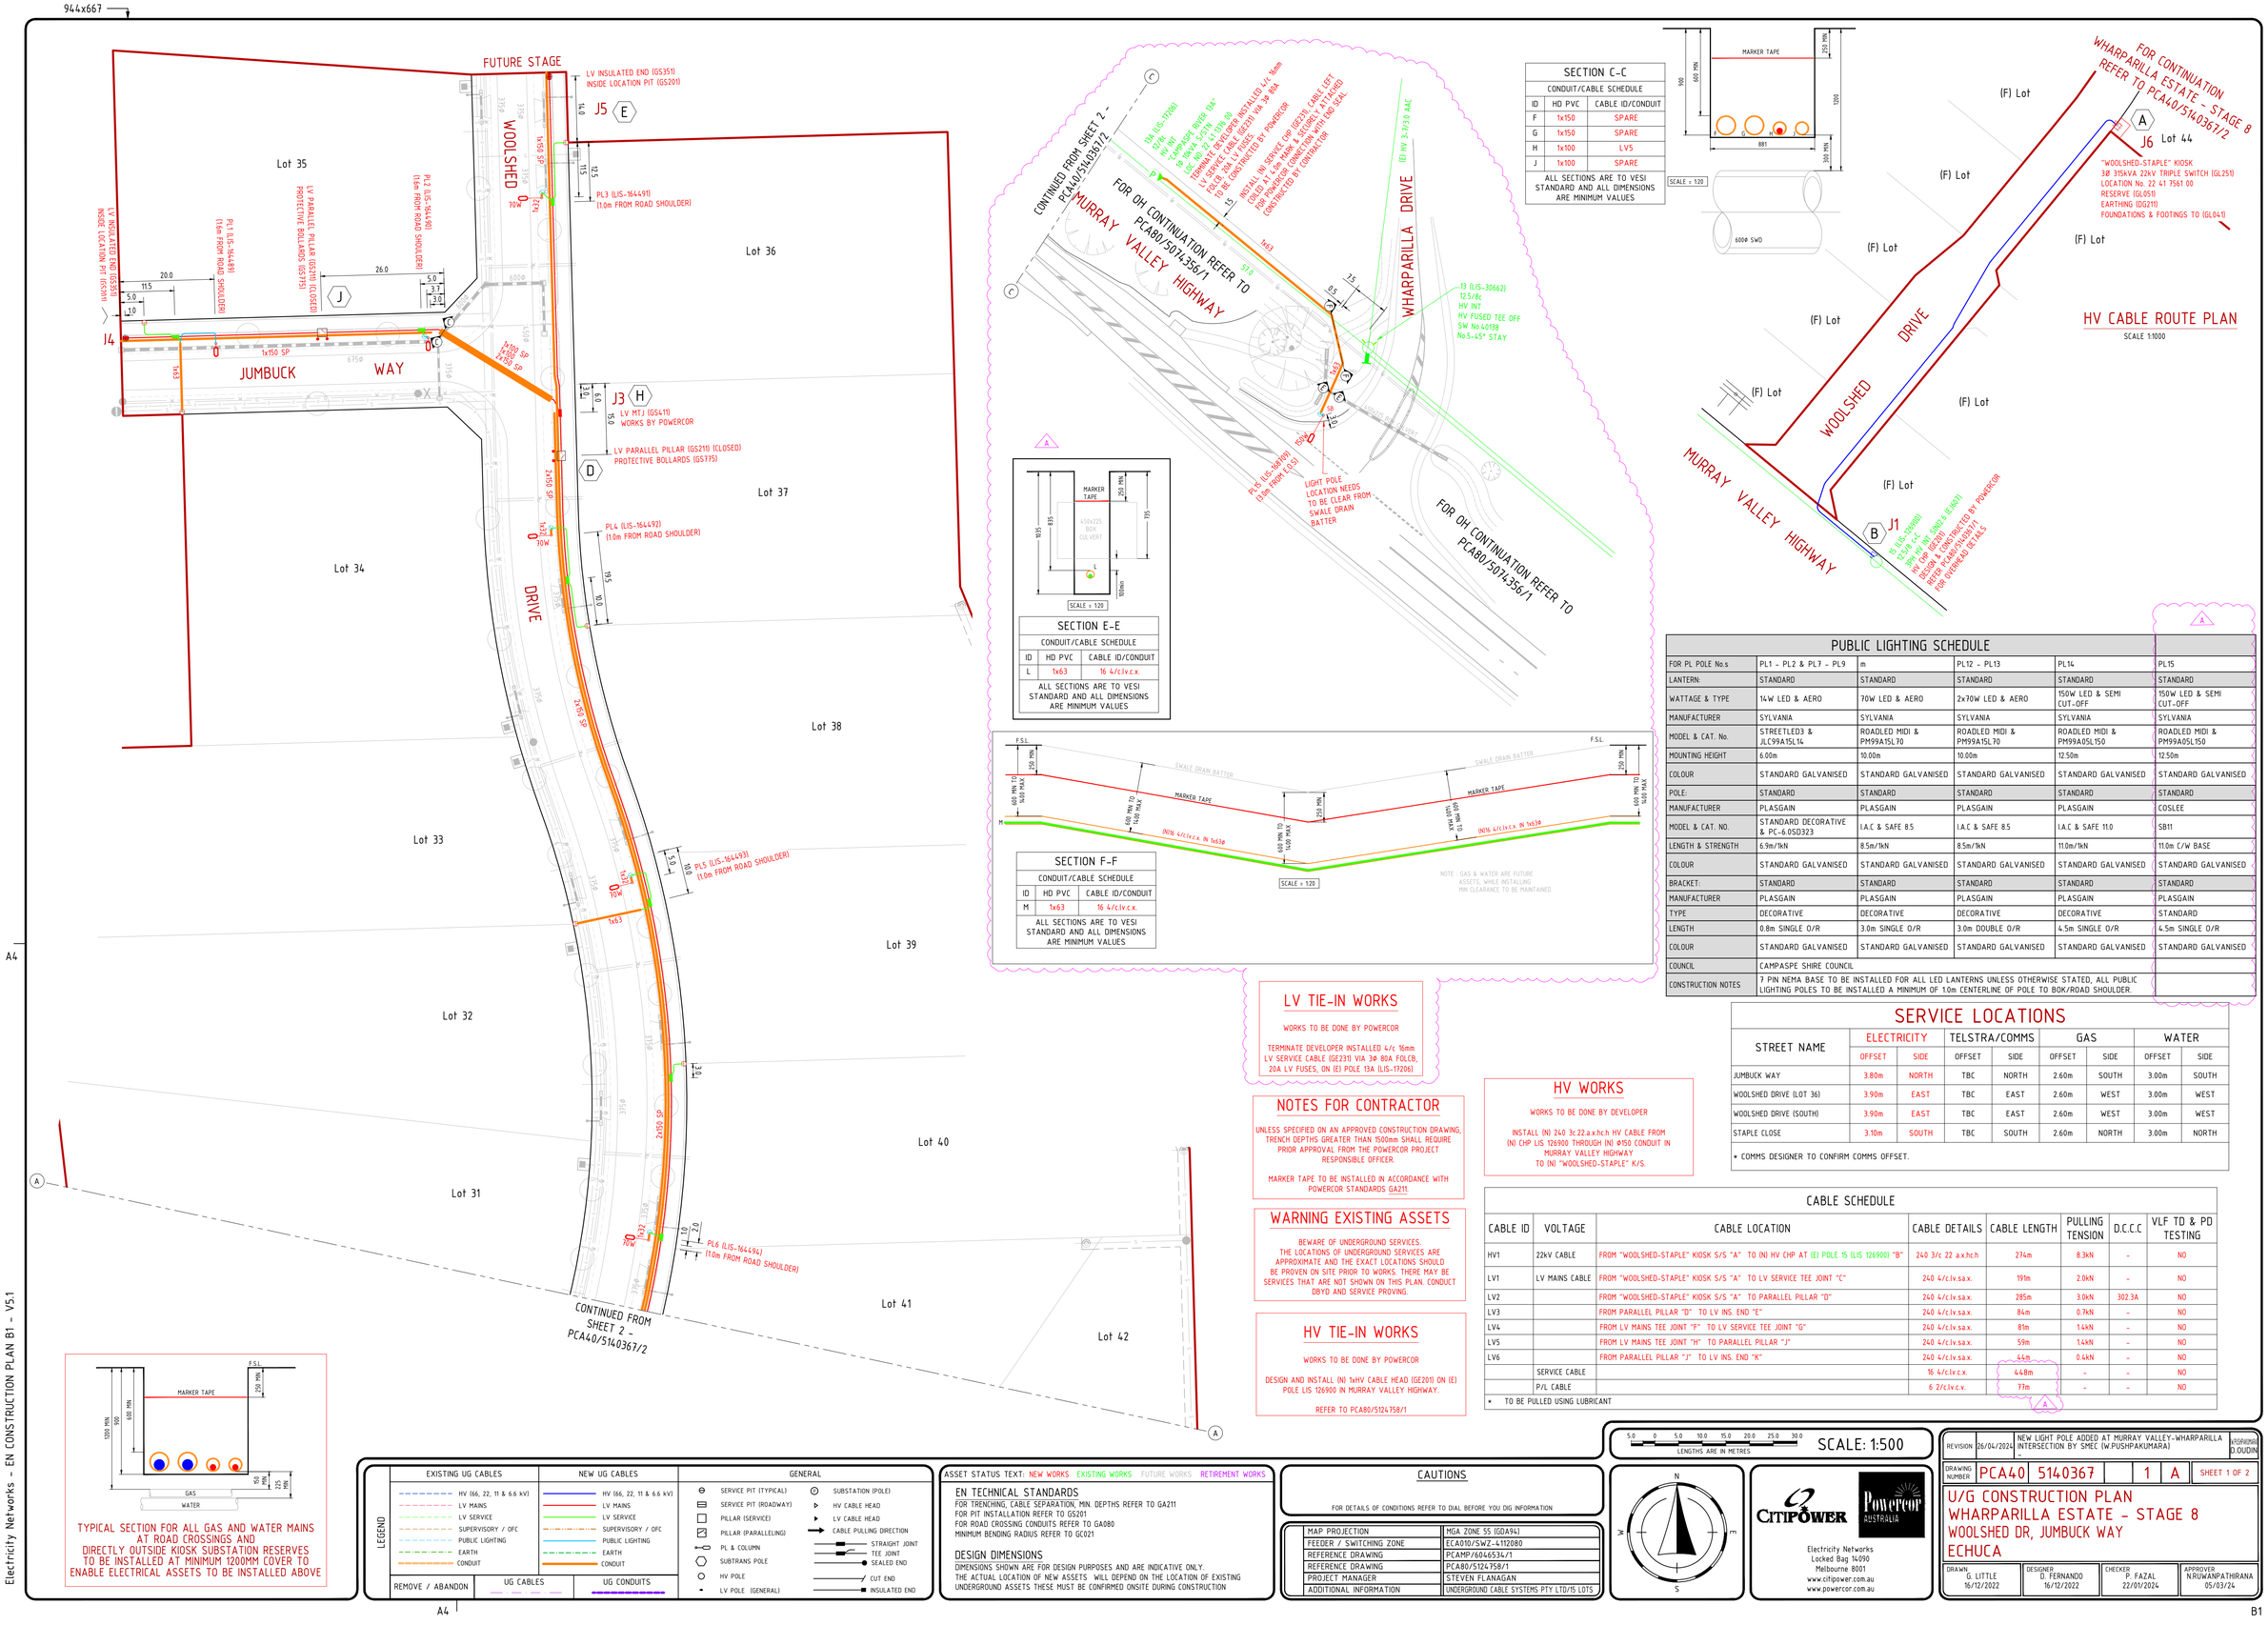

HV CABLE ROUTE PLAN

SCALE 1:1000

SECTION C-C

CONDUIT/CABLE SCHEDULE

ID	HD PVC	CABLE ID/CONDUIT
F	1x150	SPARE
G	1x150	SPARE
H	1x100	LV5
J	1x100	SPARE

ALL SECTIONS ARE TO VESI STANDARD AND ALL DIMENSIONS ARE MINIMUM VALUES

SECTION E-E

CONDUIT/CABLE SCHEDULE

ID	HD PVC	CABLE ID/CONDUIT
L	1x63	16 4/c\v.c.x.

ALL SECTIONS ARE TO VESI STANDARD AND ALL DIMENSIONS ARE MINIMUM VALUES

SECTION F-F

CONDUIT/CABLE SCHEDULE

ID	HD PVC	CABLE ID/CONDUIT
M	1x63	16 4/c\v.c.x.

ALL SECTIONS ARE TO VESI STANDARD AND ALL DIMENSIONS ARE MINIMUM VALUES

PUBLIC LIGHTING SCHEDULE

FOR PL POLE No.s	PL1 - PL2 & PL7 - PL9	m	PL12 - PL13	PL14	PL15
LANTERN:	STANDARD	STANDARD	STANDARD	STANDARD	STANDARD
WATTAGE & TYPE	14W LED & AERO	70W LED & AERO	2x70W LED & AERO	150W LED & SEMI CUT-OFF	150W LED & SEMI CUT-OFF
MANUFACTURER	SYLVANIA	SYLVANIA	SYLVANIA	SYLVANIA	SYLVANIA
MODEL & CAT. No.	STREETLED3 & JLC99A15L14	ROADLED MIDI & PM99A15L70	ROADLED MIDI & PM99A15L70	ROADLED MIDI & PM99A05L150	ROADLED MIDI & PM99A05L150
MOUNTING HEIGHT	6.00m	10.00m	10.00m	12.50m	12.50m
COLOUR	STANDARD GALVANISED	STANDARD GALVANISED	STANDARD GALVANISED	STANDARD GALVANISED	STANDARD GALVANISED
POLE:	STANDARD	STANDARD	STANDARD	STANDARD	STANDARD
MANUFACTURER	PLASGAIN	PLASGAIN	PLASGAIN	PLASGAIN	COSLEE
MODEL & CAT. NO.	STANDARD DECORATIVE & PC-6.0SD323	I.A.C & SAFE 8.5	I.A.C & SAFE 8.5	I.A.C & SAFE 11.0	SB11
LENGTH & STRENGTH	6.9m/1kN	8.5m/1kN	8.5m/1kN	11.0m/1kN	11.0m C/W BASE
COLOUR	STANDARD GALVANISED	STANDARD GALVANISED	STANDARD GALVANISED	STANDARD GALVANISED	STANDARD GALVANISED
BRACKET:	STANDARD	STANDARD	STANDARD	STANDARD	STANDARD
MANUFACTURER	PLASGAIN	PLASGAIN	PLASGAIN	PLASGAIN	PLASGAIN
TYPE	DECORATIVE	DECORATIVE	DECORATIVE	DECORATIVE	STANDARD
LENGTH	0.8m SINGLE O/R	3.0m SINGLE O/R	3.0m DOUBLE O/R	4.5m SINGLE O/R	4.5m SINGLE O/R
COLOUR	STANDARD GALVANISED	STANDARD GALVANISED	STANDARD GALVANISED	STANDARD GALVANISED	STANDARD GALVANISED
COUNCIL	CAMPASPE SHIRE COUNCIL				
CONSTRUCTION NOTES	7 PIN NEMA BASE TO BE INSTALLED FOR ALL LED LANTERNS UNLESS OTHERWISE STATED, ALL PUBLIC LIGHTING POLES TO BE INSTALLED A MINIMUM OF 1.0m CENTERLINE OF POLE TO BOK/ROAD SHOULDER.				

LV TIE-IN WORKS

WORKS TO BE DONE BY POWERCOR

TERMINATE DEVELOPER INSTALLED 4/c 16mm LV SERVICE CABLE (GE231) VIA 3Ø 80A FOLCB, 20A LV FUSES, ON (E) POLE 13A (LIS-17206)

NOTES FOR CONTRACTOR

UNLESS SPECIFIED ON AN APPROVED CONSTRUCTION DRAWING, TRENCH DEPTHS GREATER THAN 1500mm SHALL REQUIRE PRIOR APPROVAL FROM THE POWERCOR PROJECT RESPONSIBLE OFFICER.

MARKER TAPE TO BE INSTALLED IN ACCORDANCE WITH POWERCOR STANDARDS GA211.

WARNING EXISTING ASSETS

BEWARE OF UNDERGROUND SERVICES.
THE LOCATIONS OF UNDERGROUND SERVICES ARE APPROXIMATE AND THE EXACT LOCATIONS SHOULD BE PROVEN ON SITE PRIOR TO WORKS. THERE MAY BE SERVICES THAT ARE NOT SHOWN ON THIS PLAN. CONDUCT DBYD AND SERVICE PROVING.

HV TIE-IN WORKS

WORKS TO BE DONE BY POWERCOR

DESIGN AND INSTALL (N) 1xHV CABLE HEAD (GE201) ON (E) POLE LIS 126900 IN MURRAY VALLEY HIGHWAY.

REFER TO PCA80/5124758/1

HV WORKS

WORKS TO BE DONE BY DEVELOPER

INSTALL (N) 240 3c.22.a.xh.c.h HV CABLE FROM (N) CHP LIS 126900 THROUGH (N) Ø150 CONDUIT IN MURRAY VALLEY HIGHWAY TO (N) "WOOLSHED-STAPLE" K/S.

SERVICE LOCATIONS

STREET NAME	ELECTRICITY		TELSTRA/COMMS		GAS		WATER	
	OFFSET	SIDE	OFFSET	SIDE	OFFSET	SIDE	OFFSET	SIDE
JUMBUCK WAY	3.80m	NORTH	TBC	NORTH	2.60m	SOUTH	3.00m	SOUTH
WOOLSHED DRIVE (LOT 36)	3.90m	EAST	TBC	EAST	2.60m	WEST	3.00m	WEST
WOOLSHED DRIVE (SOUTH)	3.90m	EAST	TBC	EAST	2.60m	WEST	3.00m	WEST
STAPLE CLOSE	3.10m	SOUTH	TBC	SOUTH	2.60m	NORTH	3.00m	NORTH

* COMMS DESIGNER TO CONFIRM COMMS OFFSET.

CABLE SCHEDULE

CABLE ID	VOLTAGE	CABLE LOCATION	CABLE DETAILS	CABLE LENGTH	PULLING TENSION	D.C.C.C	VLF TD & PD TESTING
HV1	22kV CABLE	FROM "WOOLSHED-STAPLE" KIOSK S/S "A" TO (N) HV CHP AT (E) POLE 15 (LIS 126900) "B"	240 3/c 22 a.x.h.c.h	274m	8.3kN	-	NO
LV1	LV MAINS CABLE	FROM "WOOLSHED-STAPLE" KIOSK S/S "A" TO LV SERVICE TEE JOINT "C"	240 4/c\v.sa.x.	191m	2.0kN	-	NO
LV2		FROM "WOOLSHED-STAPLE" KIOSK S/S "A" TO PARALLEL PILLAR "D"	240 4/c\v.sa.x.	285m	3.0kN	302.3A	NO
LV3		FROM PARALLEL PILLAR "D" TO LV INS. END "E"	240 4/c\v.sa.x.	84m	0.7kN	-	NO
LV4		FROM LV MAINS TEE JOINT "F" TO LV SERVICE TEE JOINT "G"	240 4/c\v.sa.x.	81m	1.4kN	-	NO
LV5		FROM LV MAINS TEE JOINT "H" TO PARALLEL PILLAR "J"	240 4/c\v.sa.x.	59m	1.4kN	-	NO
LV6		FROM PARALLEL PILLAR "J" TO LV INS. END "K"	240 4/c\v.sa.x.	44m	0.4kN	-	NO
	SERVICE CABLE		16 4/c\v.c.x.	448m	-	-	NO
	P/L CABLE		6 2/c\v.c.v.	77m	-	-	NO

* TO BE PULLED USING LUBRICANT

TYPICAL SECTION FOR ALL GAS AND WATER MAINS AT ROAD CROSSINGS AND DIRECTLY OUTSIDE KIOSK SUBSTATION RESERVES TO BE INSTALLED AT MINIMUM 1200MM COVER TO ENABLE ELECTRICAL ASSETS TO BE INSTALLED ABOVE

LEGEND

EXISTING UG CABLES	NEW UG CABLES	GENERAL
HV (66, 22, 11 & 6.6 kV)	HV (66, 22, 11 & 6.6 kV)	SERVICE PIT (TYPICAL)
LV MAINS	LV MAINS	SERVICE PIT (ROADWAY)
LV SERVICE	LV SERVICE	PILLAR (SERVICE)
SUPERVISORY / OFC	SUPERVISORY / OFC	PILLAR (PARALLELING)
PUBLIC LIGHTING	PUBLIC LIGHTING	PL & COLUMN
EARTH	EARTH	SUBTRANS POLE
CONDUIT	CONDUIT	HV POLE
REMOVE / ABANDON	UG CABLES	LV POLE (GENERAL)
	UG CONDUITS	SUBSTATION (POLE)
		HV CABLE HEAD
		LV CABLE HEAD
		CABLE PULLING DIRECTION
		STRAIGHT JOINT
		TEE JOINT
		SEALED END
		CUT END
		INSULATED END

ASSET STATUS TEXT: NEW WORKS EXISTING WORKS FUTURE WORKS RETIREMENT WORKS

EN TECHNICAL STANDARDS

FOR TRENCHING, CABLE SEPARATION, MIN. DEPTHS REFER TO GA211
FOR PIT INSTALLATION REFER TO GS201
FOR ROAD CROSSING CONDUITS REFER TO GA080
MINIMUM BENDING RADIUS REFER TO GC021

DESIGN DIMENSIONS

DIMENSIONS SHOWN ARE FOR DESIGN PURPOSES AND ARE INDICATIVE ONLY.
THE ACTUAL LOCATION OF NEW ASSETS WILL DEPEND ON THE LOCATION OF EXISTING UNDERGROUND ASSETS THESE MUST BE CONFIRMED ONSITE DURING CONSTRUCTION

CAUTIONS

FOR DETAILS OF CONDITIONS REFER TO DIAL BEFORE YOU DIG INFORMATION

MAP PROJECTION	MGA ZONE 55 (GDA94)
FEEDER / SWITCHING ZONE	ECA010/SW2-4112080
REFERENCE DRAWING	PCAMP/6046534/1
REFERENCE DRAWING	PCA80/5124758/1
PROJECT MANAGER	STEVEN FLANAGAN
ADDITIONAL INFORMATION	UNDERGROUND CABLE SYSTEMS PTY LTD/15 LOTS

5.0 0 5.0 10.0 15.0 20.0 25.0 30.0
LENGTHS ARE IN METRES

SCALE: 1:500

N E S W

CITIPOWER POWERCOR AUSTRALIA

Electricity Networks
Locked Bag 14090
Melbourne 8001
www.citipower.com.au
www.powercor.com.au

REVISION	26/04/2024	NEW LIGHT POLE ADDED AT MURRAY VALLEY-WHARPARILLA INTERSECTION BY SMEC (W.PUSHPAKUMARA)				VERIFIER/APPR D.OUDIN
	-					

DRAWING NUMBER	PCA40	5140367		1	A	SHEET 1 OF 2

U/G CONSTRUCTION PLAN
WHARPARILLA ESTATE - STAGE 8
WOOLSHED DR, JUMBUCK WAY
ECHUCA

DRAWN	DESIGNER	CHECKER	APPROVER
G. LITTLE 16/12/2022	D. FERNANDO 16/12/2022	P. FAZAL 22/01/2024	N.RUWANPATHIRANA 05/03/24

Electricity Networks - EN CONSTRUCTION PLAN B1 - V5.1


A4

A4

B1

944x667

PUBLIC LIGHTING SCHEDULE					
FOR PL POLE No.s	PL1 - PL2 & PL7 - PL9	PL3 - PL6 & PL10 - PL11	PL12 - PL13	PL14	PL15
LANTERN:	STANDARD	STANDARD	STANDARD	STANDARD	STANDARD
WATTAGE & TYPE	14W LED & AERO	70W LED & AERO	2x70W LED & AERO	150W LED & SEMI CUT-OFF	150W LED & SEMI CUT-OFF
MANUFACTURER	SYLVANIA	SYLVANIA	SYLVANIA	SYLVANIA	SYLVANIA
MODEL & CAT. No.	STREETLED3 & JLC99A15L14	ROADLED MIDI & PM99A15L70	ROADLED MIDI & PM99A15L70	ROADLED MIDI & PM99A05L150	ROADLED MIDI & PM99A05L150
MOUNTING HEIGHT	6.00m	10.00m	10.00m	12.50m	12.50m
COLOUR	STANDARD GALVANISED	STANDARD GALVANISED	STANDARD GALVANISED	STANDARD GALVANISED	STANDARD GALVANISED
POLE:	STANDARD	STANDARD	STANDARD	STANDARD	STANDARD
MANUFACTURER	PLASGAIN	PLASGAIN	PLASGAIN	PLASGAIN	COSLEE
MODEL & CAT. NO.	STANDARD DECORATIVE & PC-6.0SD323	I.A.C & SAFE 8.5	I.A.C & SAFE 8.5	I.A.C & SAFE 11.0	SB11
LENGTH & STRENGTH	6.9m/1kN	8.5m/1kN	8.5m/1kN	11.0m/1kN	11.0m C/W BASE
COLOUR	STANDARD GALVANISED	STANDARD GALVANISED	STANDARD GALVANISED	STANDARD GALVANISED	STANDARD GALVANISED
BRACKET:	STANDARD	STANDARD	STANDARD	STANDARD	STANDARD
MANUFACTURER	PLASGAIN	PLASGAIN	PLASGAIN	PLASGAIN	PLASGAIN
TYPE	DECORATIVE	DECORATIVE	DECORATIVE	DECORATIVE	STANDARD
LENGTH	0.8m SINGLE O/R	3.0m SINGLE O/R	3.0m DOUBLE O/R	4.5m SINGLE O/R	4.5m SINGLE O/R
COLOUR	STANDARD GALVANISED	STANDARD GALVANISED	STANDARD GALVANISED	STANDARD GALVANISED	STANDARD GALVANISED
COUNCIL	CAMPASPE SHIRE COUNCIL				
CONSTRUCTION NOTES	7 PIN NEMA BASE TO BE INSTALLED FOR ALL LED LANTERNS UNLESS OTHERWISE STATED, ALL PUBLIC LIGHTING POLES TO BE INSTALLED A MINIMUM OF 1.0m CENTERLINE OF POLE TO BOK/ROAD SHOULDER.				




TYPICAL SECTION FOR ALL GAS AND WATER MAINS AT ROAD CROSSINGS AND DIRECTLY OUTSIDE KIOSK SUBSTATION RESERVES TO BE INSTALLED AT MINIMUM 1200MM COVER TO ENABLE ELECTRICAL ASSETS TO BE INSTALLED ABOVE

SECTION A-A

CONDUIT/CABLE SCHEDULE		
ID	HD PVC	CABLE ID / CONDUIT
A	1x150	SPARE
B	1x150	SPARE
C	1x150	SPARE
D	1x100	LV2
E	1x100	SPARE

ALL SECTIONS ARE TO VESI STANDARD AND ALL DIMENSIONS ARE MINIMUM VALUES

FUTURE HV 240 3c CABLE DERATED CURRENT AT DEPTH 1.8m = 314.8A APPROVED BY STEVEN FLANAGAN (08/02/24)




SECTION B-B

CONDUIT/CABLE SCHEDULE		
ID	HD PVC	CABLE ID / CONDUIT
A	1x150	SPARE
B	1x150	SPARE
C	1x150	SPARE
D	1x100	LV2
E	1x100	SPARE

ALL SECTIONS ARE TO VESI STANDARD AND ALL DIMENSIONS ARE MINIMUM VALUES

FUTURE HV 240 3c CABLE DERATED CURRENT AT DEPTH 1.8m = 314.8A APPROVED BY STEVEN FLANAGAN (08/02/24)



NOTES FOR CONTRACTOR

UNLESS SPECIFIED ON AN APPROVED CONSTRUCTION DRAWING, TRENCH DEPTHS GREATER THAN 1500mm SHALL REQUIRE PRIOR APPROVAL FROM THE POWERCOR PROJECT RESPONSIBLE OFFICER.

MARKER TAPE TO BE INSTALLED IN ACCORDANCE WITH POWERCOR STANDARDS GA211.

WARNING EXISTING ASSETS

BEWARE OF UNDERGROUND SERVICES.
THE LOCATIONS OF UNDERGROUND SERVICES ARE APPROXIMATE AND THE EXACT LOCATIONS SHOULD BE PROVEN ON SITE PRIOR TO WORKS. THERE MAY BE SERVICES THAT ARE NOT SHOWN ON THIS PLAN. CONDUCT DBYD AND SERVICE PROVING.

HV TIE-IN WORKS

WORKS TO BE DONE BY POWERCOR

DESIGN AND INSTALL (N) 1xHV CABLE HEAD (GE201) ON (E) POLE LIS 126900 IN MURRAY VALLEY HIGHWAY.

REFER TO PCA80/5124758/1

HV WORKS

WORKS TO BE DONE BY DEVELOPER

INSTALL (N) 240 3c.22.a.xh.h HV CABLE FROM (N) CHP LIS 126900 THROUGH (N) ø150 CONDUIT IN MURRAY VALLEY HIGHWAY TO (N) "WOOLSHED-STAPLE" K/S.

LV TIE-IN WORKS

WORKS TO BE DONE BY POWERCOR


TERMINATE DEVELOPER INSTALLED 4/c 16mm LV SERVICE CABLE (GE231) VIA 3ø 80A FOLCB, 20A LV FUSES, ON (E) POLE 13A (LIS-17206)

SECTION D-D

CONDUIT/CABLE SCHEDULE		
ID	HD PVC	CABLE ID/CONDUIT
K	1x63	LVS

ALL SECTIONS ARE TO VESI STANDARD AND ALL DIMENSIONS ARE MINIMUM VALUES


SCALE = 1:20



SERVICE LOCATIONS

STREET NAME	ELECTRICITY		TELSTRA/COMMS		GAS		WATER	
	OFFSET	SIDE	OFFSET	SIDE	OFFSET	SIDE	OFFSET	SIDE
JUMBUCK WAY	3.80m	NORTH	TBC	NORTH	2.60m	SOUTH	3.00m	SOUTH
WOOLSHED DRIVE (LOT 36)	3.90m	EAST	TBC	EAST	2.60m	WEST	3.00m	WEST
WOOLSHED DRIVE (SOUTH)	3.90m	EAST	TBC	EAST	2.60m	WEST	3.00m	WEST
STAPLE CLOSE	3.10m	SOUTH	TBC	SOUTH	2.60m	NORTH	3.00m	NORTH

* COMMS DESIGNER TO CONFIRM COMMS OFFSET.

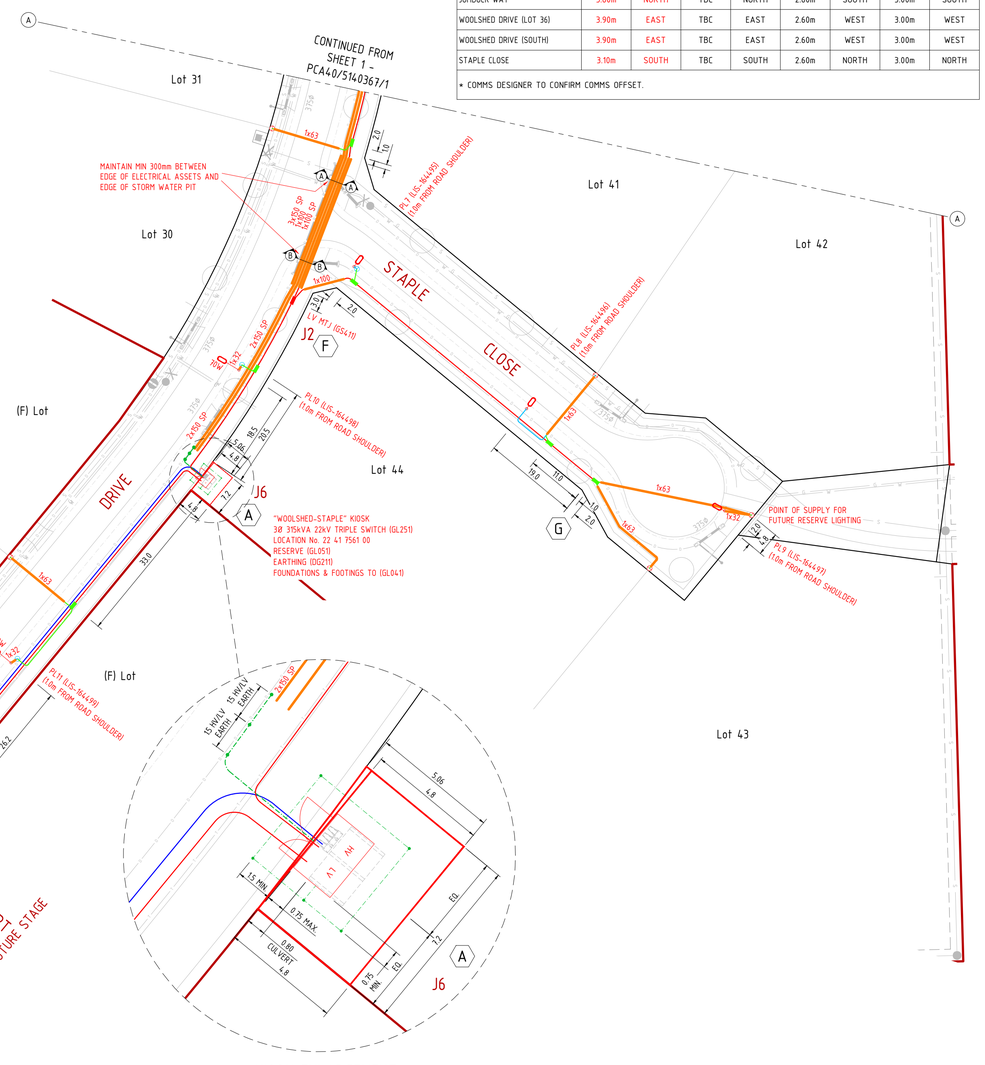


KIOSK ENLARGEMENT
SCALE 1:100

LABEL SCHEDULE

ITEM No.	DESCRIPTION	LABEL	STANDARD
1	SUBSTATION NAME PLATE	WOOLSHED-STAPLE 22 41 7561 00	DS411
2	HV SWITCH LABEL No.1	SW61034	DS301
3	HV SWITCH LABEL No.2	SW76386	DS301
4	HV SWITCH LABEL No.3	SW67676	DS301
5	HV CABLE No.1 -INDOOR SWITCH LABEL	SW61034 SPARE	DS301
6	HV CABLE No.2 -INDOOR SWITCH LABEL	SW76386 SPARE	DS301
7	HV CABLE No.3-INDOOR SWITCH LABEL	SW67676 HV Cable to CHP 15 (LIS-126900)	DS301
8	HV CABLE 3 - CABLE LABEL	HV Cable to CHP 15 (LIS-126900)	DS201
9	LV CIRCUIT No.1 - KIOSK FUSE STRIP	LV cct No.1 to WOOLSHED DR NORTH (IE OPP LOT 35), STAPLE CL (STJ OS LOT 44), JUMBRUCK WAY (IE OS LOT 35).	DS201
10	LV CIRCUIT No.1 - CABLE LABEL	LV cct No.1 to WOOLSHED DR NORTH (IE OPP LOT 35), STAPLE CL (STJ OS LOT 44), JUMBRUCK WAY (IE OS LOT 35).	DS201
11	LV CIRCUIT No.2 - KIOSK FUSE STRIP	LV cct No.2 to SPARE	DS201
12	LV CIRCUIT No.3 - KIOSK FUSE STRIP	LV cct No.3 to SPARE	DS201
13	LV CIRCUIT No.4 - KIOSK FUSE STRIP	LV cct No.4 to SPARE	DS201
14	LV CIRCUIT No.5 - KIOSK FUSE STRIP	LV cct No.5 to WOOLSHED DR SOUTH (STJ OS (F) LOT).	DS201
15	LV CIRCUIT No.5 - CABLE LABEL	LV cct No.5 to WOOLSHED DR SOUTH (STJ OS (F) LOT).	DS201

PROPOSED CONNECTION DIAGRAM
"WOOLSHED-STAPLE" S/S
(LOC. No. 22 41 7561 00)

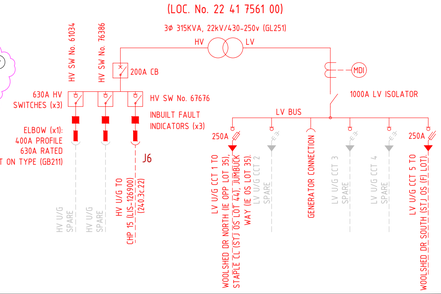

CABLE SCHEDULE							
CABLE ID	VOLTAGE	CABLE LOCATION	CABLE DETAILS	CABLE LENGTH	PULLING TENSION	D.C.C.C	VLF TD & PD TESTING
HV1	22kV CABLE	FROM "WOOLSHED-STAPLE" KIOSK S/S "A" TO (N) HV CHP AT (E) POLE 15 (LIS 126900) "B"	240 3/c 22 a.x.h.h	274m	8.3kN	-	NO
LV1	LV MAINS CABLE	FROM "WOOLSHED-STAPLE" KIOSK S/S "A" TO LV SERVICE TEE JOINT "C"	240 4/c.v.s.a.x.	191m	2.0kN	-	NO
LV2		FROM "WOOLSHED-STAPLE" KIOSK S/S "A" TO PARALLEL PILLAR "D"	240 4/c.v.s.a.x.	285m	3.0kN	302.3A	NO
LV3		FROM PARALLEL PILLAR "D" TO LV INS. END "E"	240 4/c.v.s.a.x.	84m	0.7kN	-	NO
LV4		FROM LV MAINS TEE JOINT "F" TO LV SERVICE TEE JOINT "G"	240 4/c.v.s.a.x.	81m	1.4kN	-	NO
LV5		FROM LV MAINS TEE JOINT "H" TO PARALLEL PILLAR "J"	240 4/c.v.s.a.x.	59m	1.4kN	-	NO
LV6		FROM PARALLEL PILLAR "J" TO LV INS. END "K"	240 4/c.v.s.a.x.	44m	0.4kN	-	NO
	SERVICE CABLE		16 4/c/v.c.x.	448m	-	-	NO
	P/L CABLE		6 2/c/v.c.v.	97m	-	-	NO

* TO BE PULLED USING LUBRICANT

LEGEND

EXISTING UG CABLES	NEW UG CABLES	GENERAL
HV (66, 22, 11 & 6.6 kV)	HV (66, 22, 11 & 6.6 kV)	SERVICE PIT (TYPICAL)
LV MAINS	LV MAINS	SERVICE PIT (ROADWAY)
LV SERVICE	LV SERVICE	PILLAR (SERVICE)
SUPERVISORY / OFC	SUPERVISORY / OFC	PILLAR (PARALLELING)
PUBLIC LIGHTING	PUBLIC LIGHTING	PL & COLUMN
EARTH	EARTH	SUBTRANS POLE
CONDUIT	CONDUIT	HV POLE
		LV POLE (GENERAL)
		SUBSTATION (POLE)
		HV CABLE HEAD
		LV CABLE HEAD
		CABLE PULLING DIRECTION
		STRAIGHT JOINT
		TEE JOINT
		SEALED END
		CUT END
		INSULATED END

REMOVE / ABANDON | UG CABLES | UG CONDUITS

ASSET STATUS TEXT: NEW WORKS EXISTING WORKS FUTURE WORKS RETIREMENT WORKS

EN TECHNICAL STANDARDS

FOR TRENCHING, CABLE SEPARATION, MIN. DEPTHS REFER TO GA211
FOR PIT INSTALLATION REFER TO GS201
FOR ROAD CROSSING CONDUITS REFER TO GA080
MINIMUM BENDING RADIUS REFER TO GC021

DESIGN DIMENSIONS

DIMENSIONS SHOWN ARE FOR DESIGN PURPOSES AND ARE INDICATIVE ONLY.
THE ACTUAL LOCATION OF NEW ASSETS WILL DEPEND ON THE LOCATION OF EXISTING UNDERGROUND ASSETS THESE MUST BE CONFIRMED ONSITE DURING CONSTRUCTION

CAUTIONS

FOR DETAILS OF CONDITIONS REFER TO DIAL BEFORE YOU DIG INFORMATION

MAP PROJECTION	MGA ZONE 55 (GDA94)
FEEDER / SWITCHING ZONE	ECA010/SWZ-4112080
REFERENCE DRAWING	PCAMP/6046534/1
REFERENCE DRAWING	PCA80/5124758/1
PROJECT MANAGER	STEVEN FLANAGAN
ADDITIONAL INFORMATION	UNDERGROUND CABLE SYSTEMS PTY LTD/15 LOTS

5.0 0 5.0 10.0 15.0 20.0 25.0 30.0
LENGTHS ARE IN METRES

SCALE: 1:500

N E S W

CITIPOWER Powercor AUSTRALIA

Electricity Networks
Locked Bag 14090
Melbourne 8001
www.citipower.com.au
www.powercor.com.au

REVISION	26/04/2024	NEW LIGHT POLE ADDED AT MURRAY VALLEY-WHARPARILLA INTERSECTION BY SMEC (W.PUSHPAKUMARA)	A	KRISHNAN D.OUDIN

DRAWING NUMBER: PCA40 5140367 2 A SHEET 2 OF 2

U/G CONSTRUCTION PLAN
WHARPARILLA ESTATE - STAGE 8
WOOLSHED DR, JUMBUCK WAY
ECHUCA

DRAWN	DESIGNED	CHECKED	APPROVED
G. LITTLE 16/12/2022	D. FERNANDO 16/12/2022	P. FAZAL 22/01/2024	N.RUWANPATHIRANA 05/03/24

Electricity Networks - EN CONSTRUCTION PLAN B1 - V5.1

A4

A4

B1